



AVAILABLE FAULT CURRENT  
SYMMETRICAL R. M. S. AMPERES

PEAK LET-THRU IN AMPERES

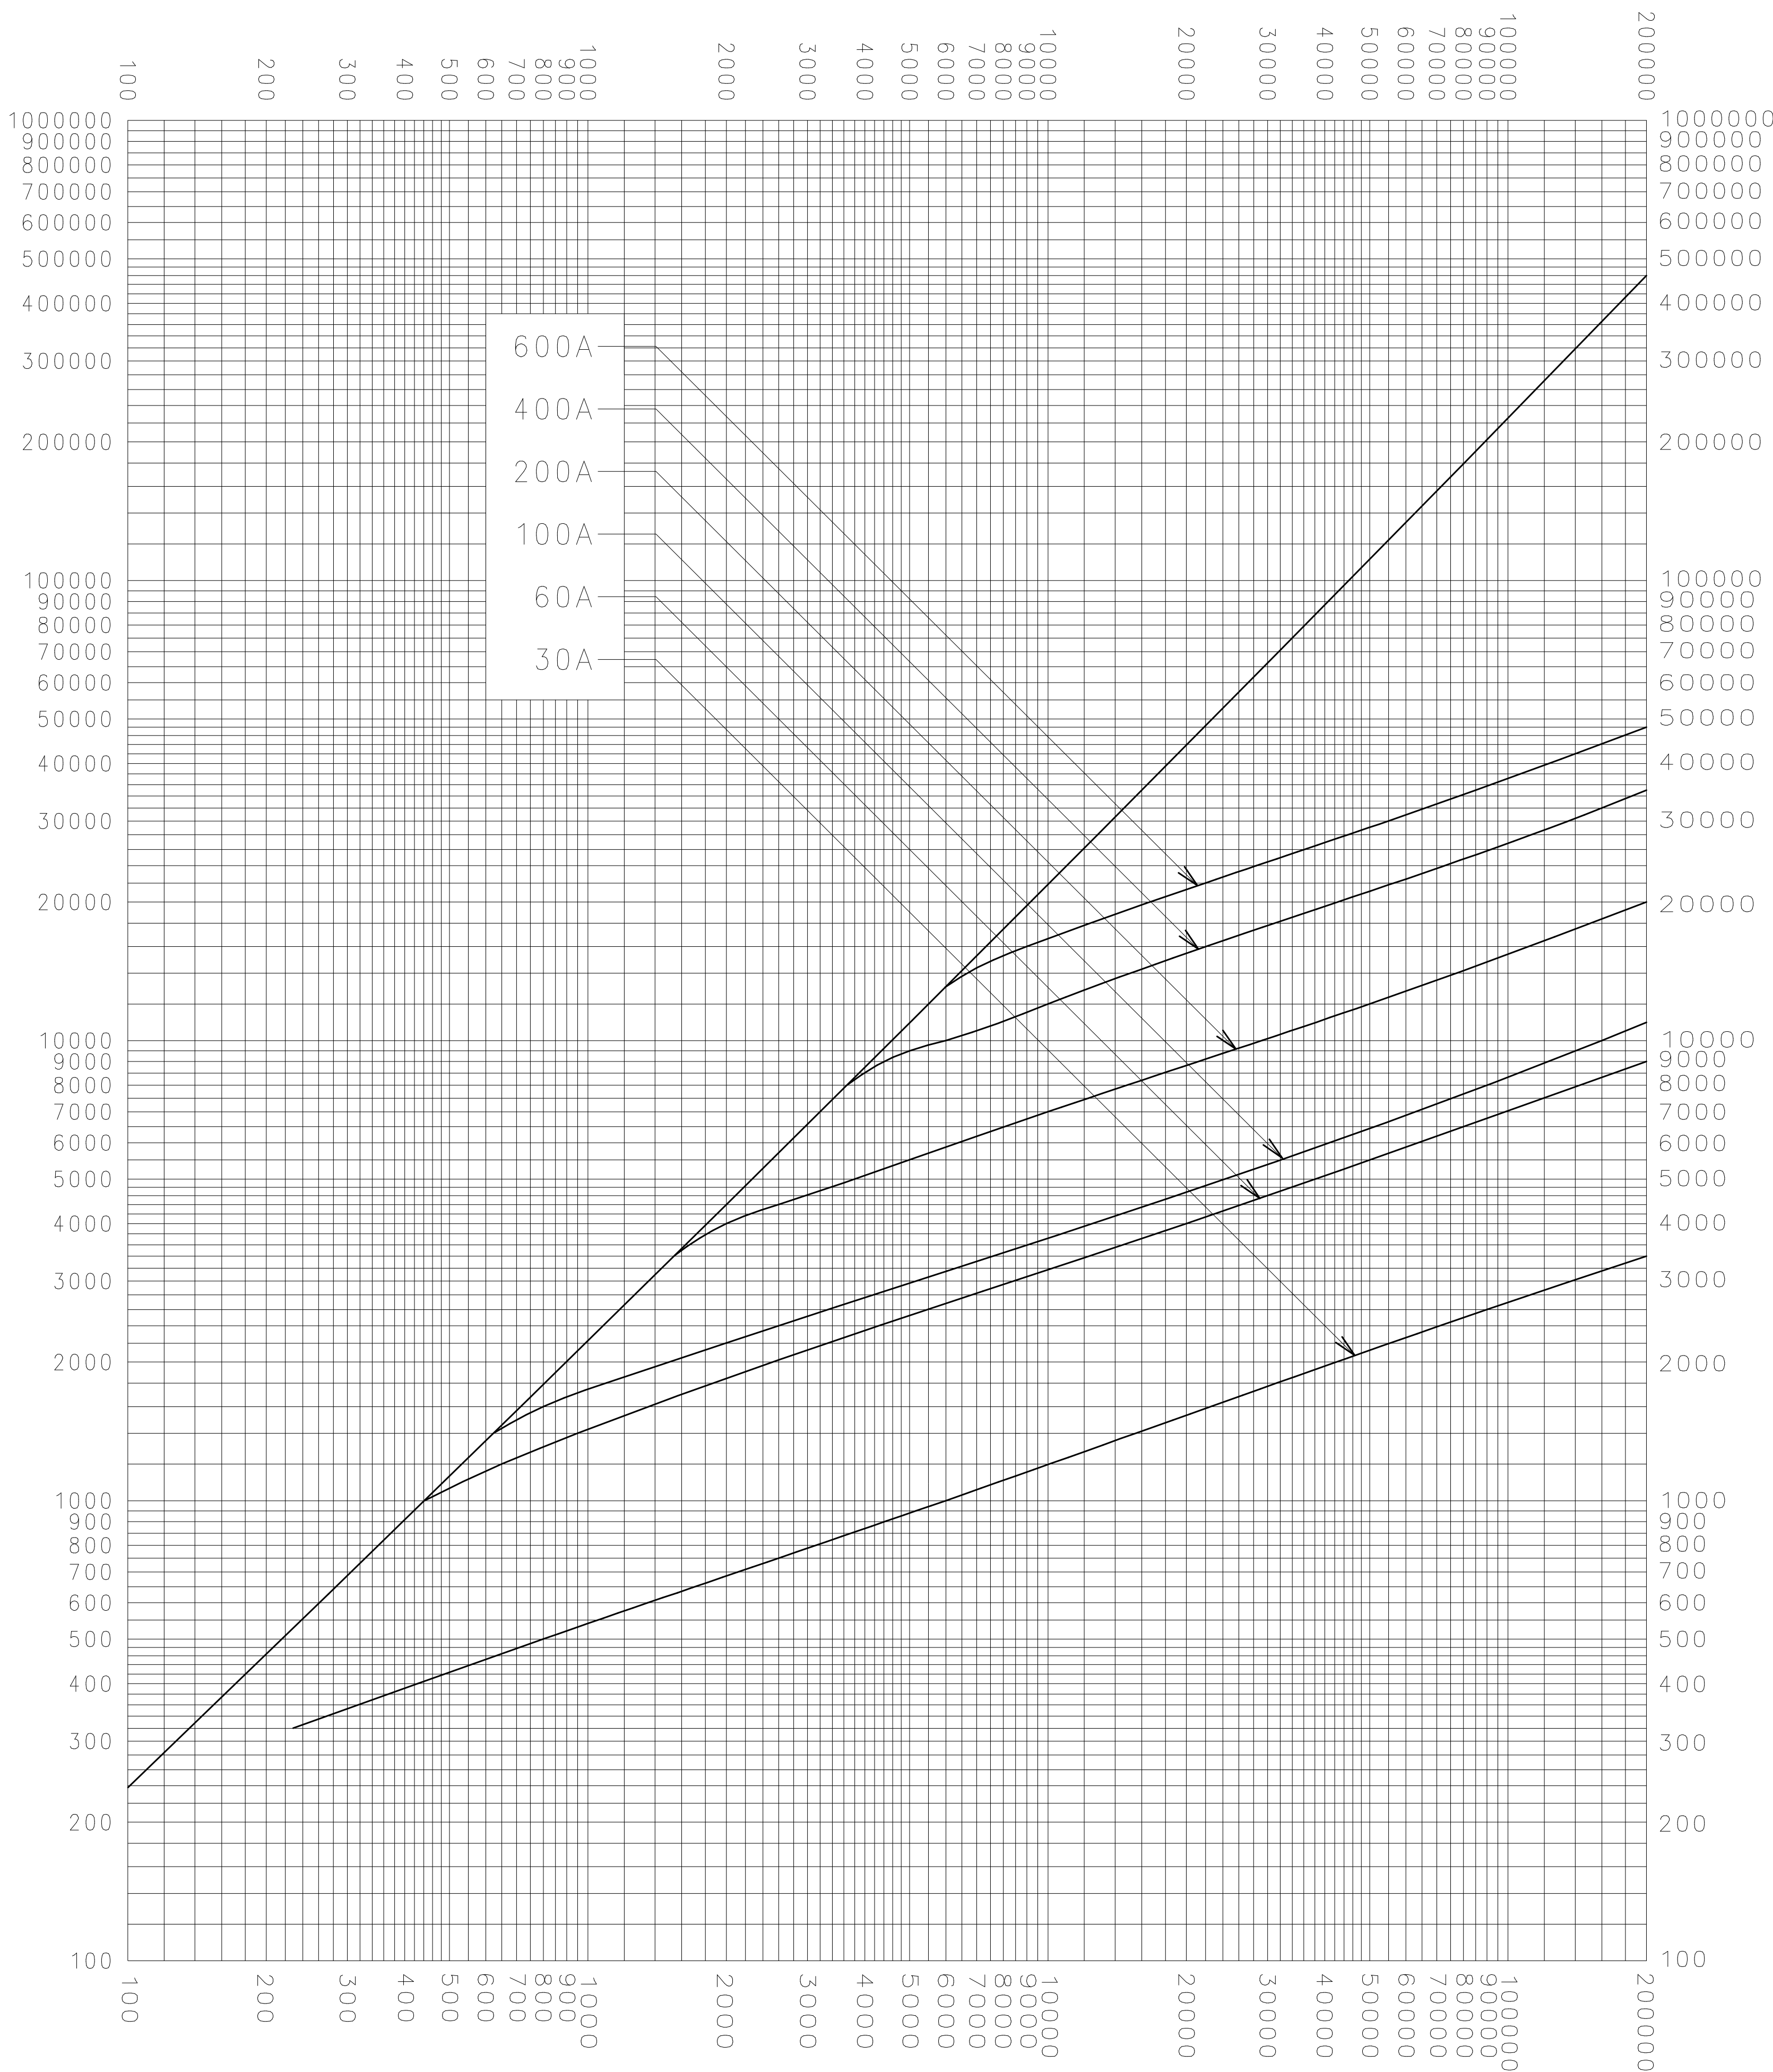

PEAK LET-THRU IN AMPERES

AVAILABLE FAULT CURRENT  
SYMMETRICAL R. M. S. AMPERES

|                                                                                                                               |                                                |
|-------------------------------------------------------------------------------------------------------------------------------|------------------------------------------------|
| TEST VOLTAGE _____ TIME CONSTANT / POWER FACTOR _____<br>BASIS FOR DATA _____                                                 | FUSE CATALOG NUMBER<br>KLNR (30A - 600A)       |
|  LITTELFUSE, INC.<br>DES PLAINES, ILL. USA | DRAWN BY LLL<br>DATE 09/06/06<br>CHECKED BY MP |
| PEAK LET-THRU CHARACTERISTIC CURVES                                                                                           | DRAWING NO. A-FCC05 (Rev. 001)                 |

-THIS DATA GENERATED ON CAD-

UNCONTROLLED  
DOCUMENT