
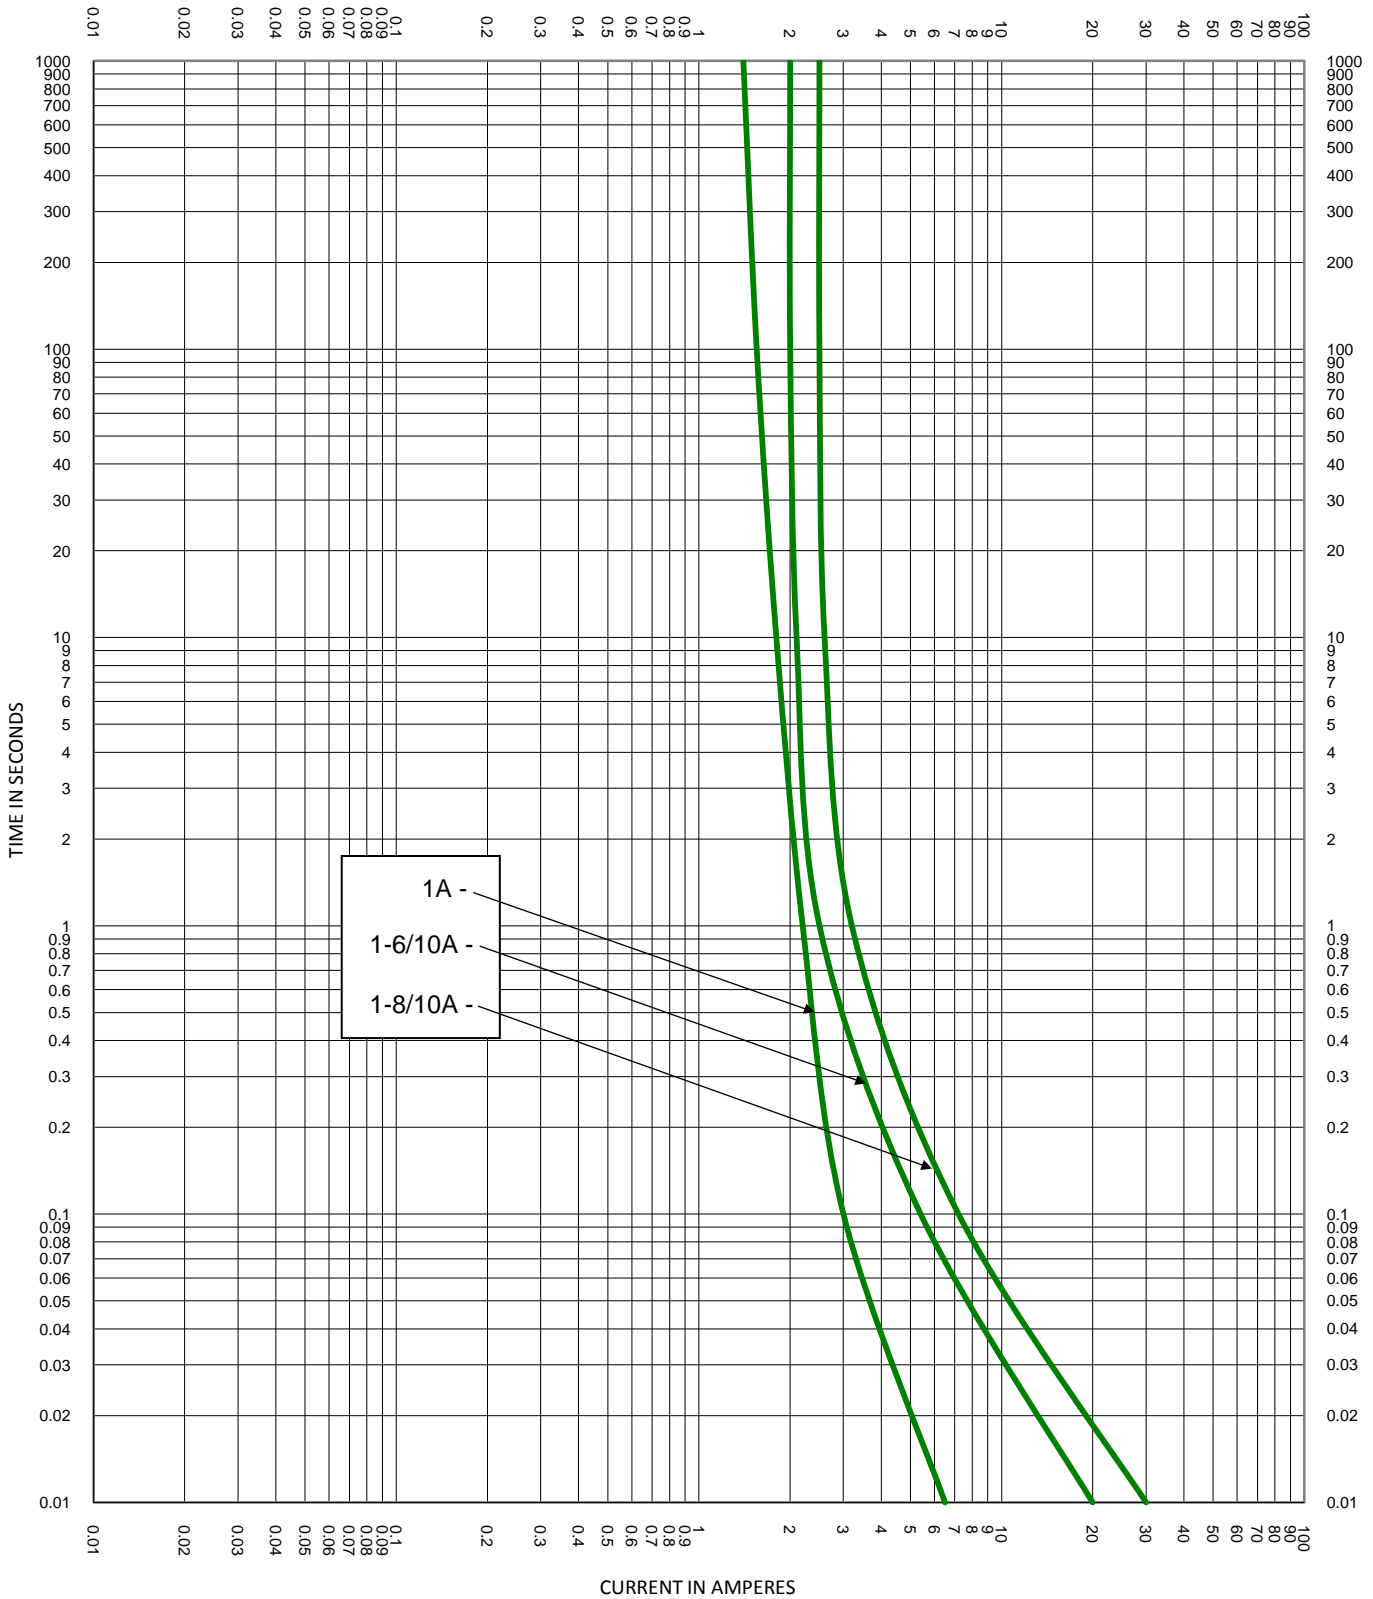

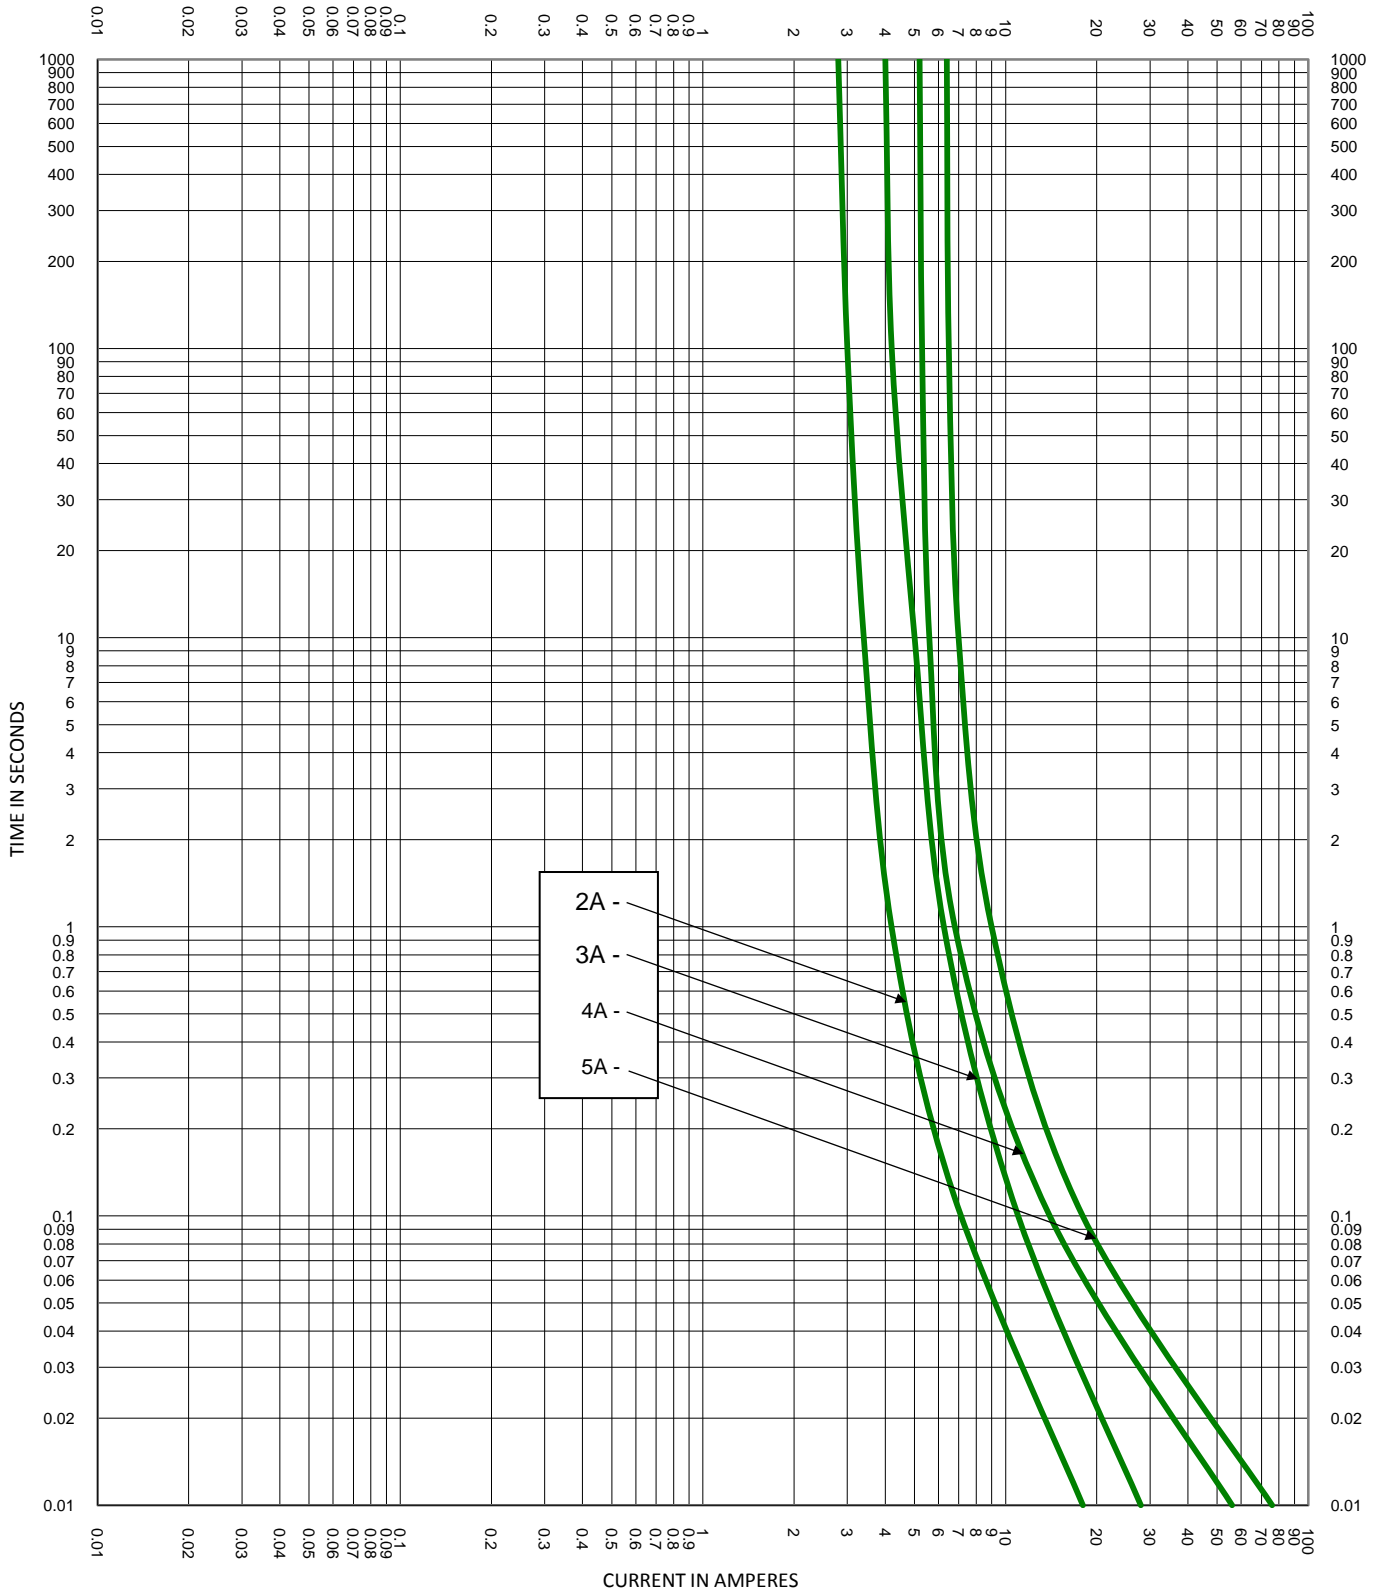



TEST VOLTAGE:	TIME CONSTANT/POWER FACTOR:	FUSE CATALOG NUMBER:
BASIS FOR DATA:		BLS 4/10A - 10A
		DRAWN BY: LLL
		DATE: 10/18/2013
		REVISION: A
TIME CURRENT CHARACTERISTIC CURVES		DRAWING NO.: FCC01-BLS SHEET 2 OF 5




TEST VOLTAGE:	TIME CONSTANT/POWER FACTOR:	FUSE CATALOG NUMBER:
BASIS FOR DATA:		BLS 4/10A - 10A
		DRAWN BY: LLL
		DATE: 10/18/2013
		REVISION: A
TIME CURRENT CHARACTERISTIC CURVES		DRAWING NO.: FCC01-BLS SHEET 3 OF 5




TEST VOLTAGE:	TIME CONSTANT/POWER FACTOR:	FUSE CATALOG NUMBER:
BASIS FOR DATA:		BLS 4/10A - 10A

	DRAWN BY: LLL DATE: 10/18/2013 REVISION: A
	DRAWING NO.: FCC01-BLS SHEET 4 OF 5

**TIME CURRENT CHARACTERISTIC CURVES**

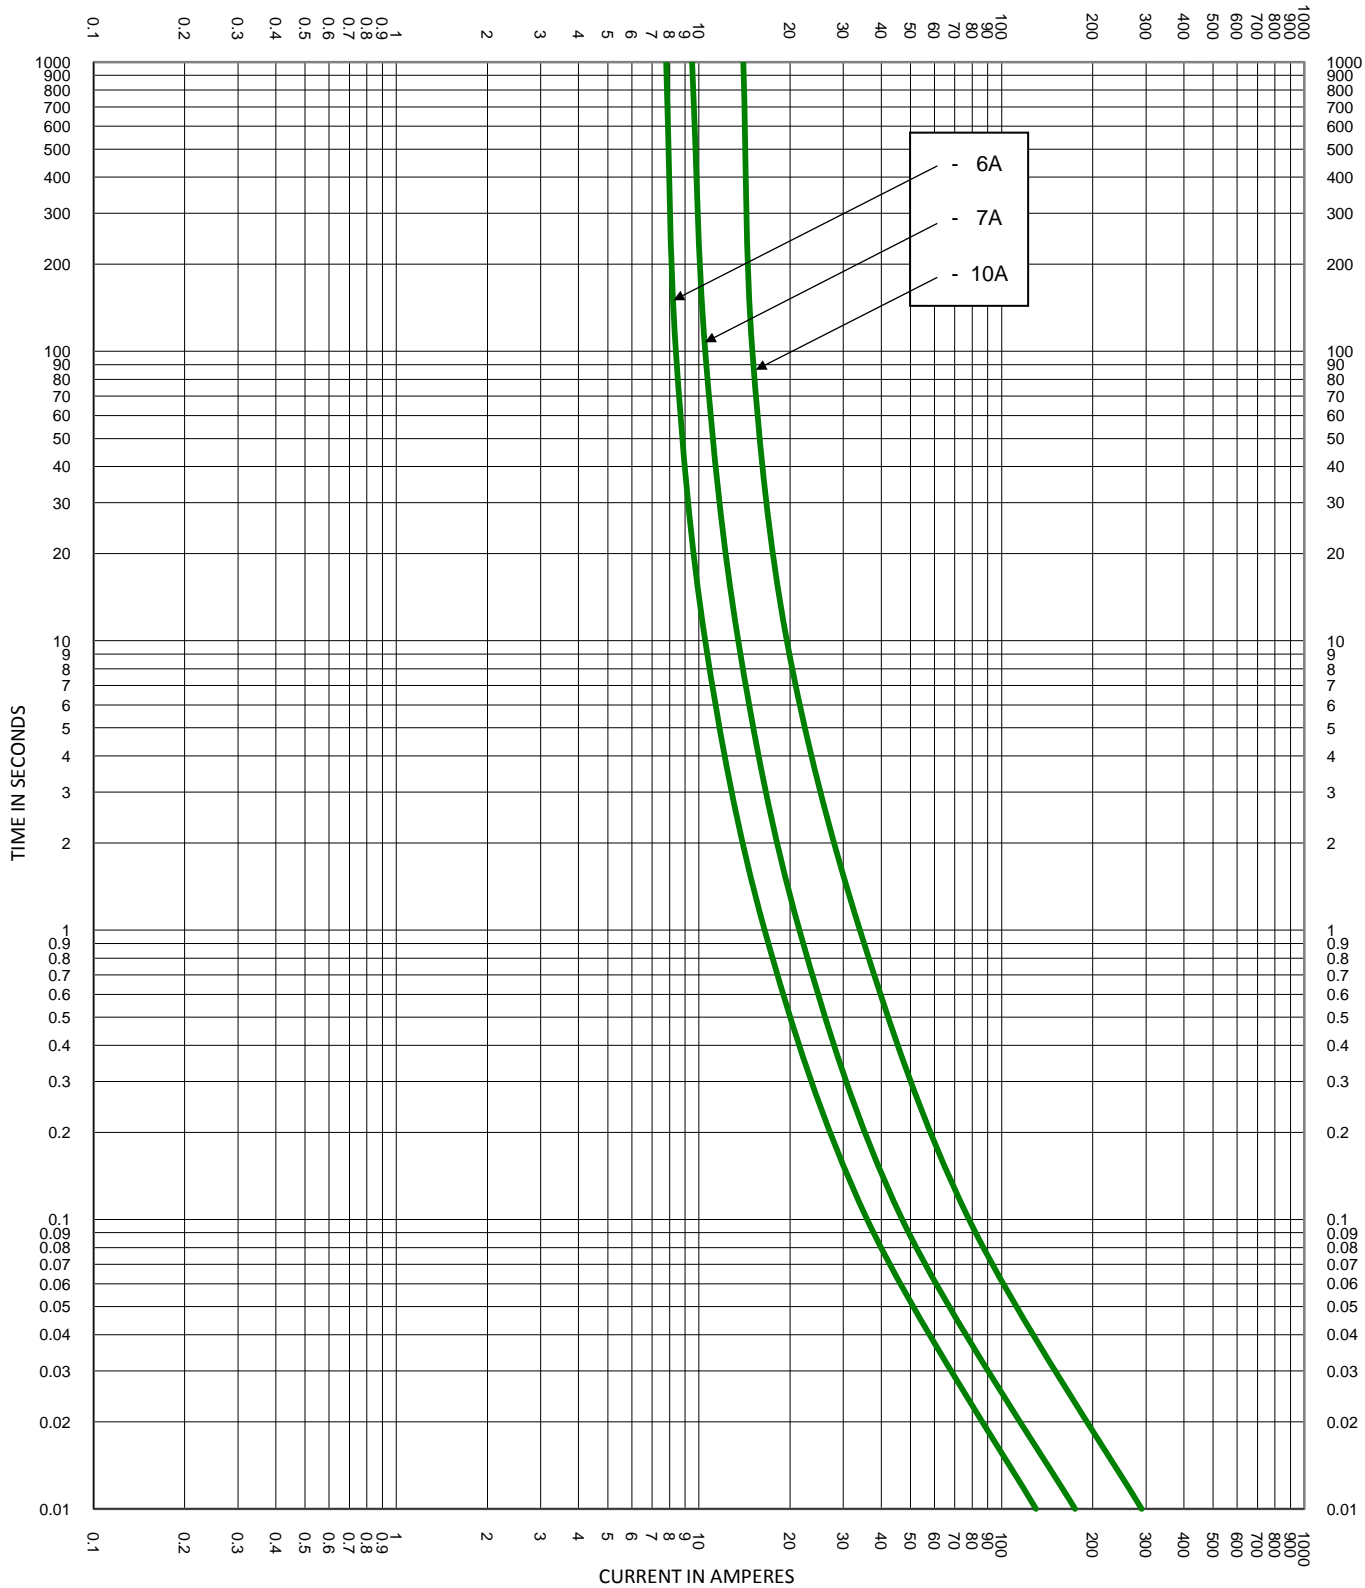

TEST VOLTAGE:	TIME CONSTANT/POWER FACTOR:	FUSE CATALOG NUMBER:
BASIS FOR DATA:		BLS 4/10A - 10A

 <b>LITTELFUSE, INC.</b> CHICAGO, IL. USA	DRAWN BY: LLL DATE: 10/18/2013 REVISION: A
	<b>TIME CURRENT CHARACTERISTIC CURVES</b>
DRAWING NO.: FCC01-BLS SHEET 5 OF 5	