


AVAILABLE FAULT CURRENT
SYMMETRICAL R. M. S. AMPERES

PEAK LET-THRU IN AMPERES

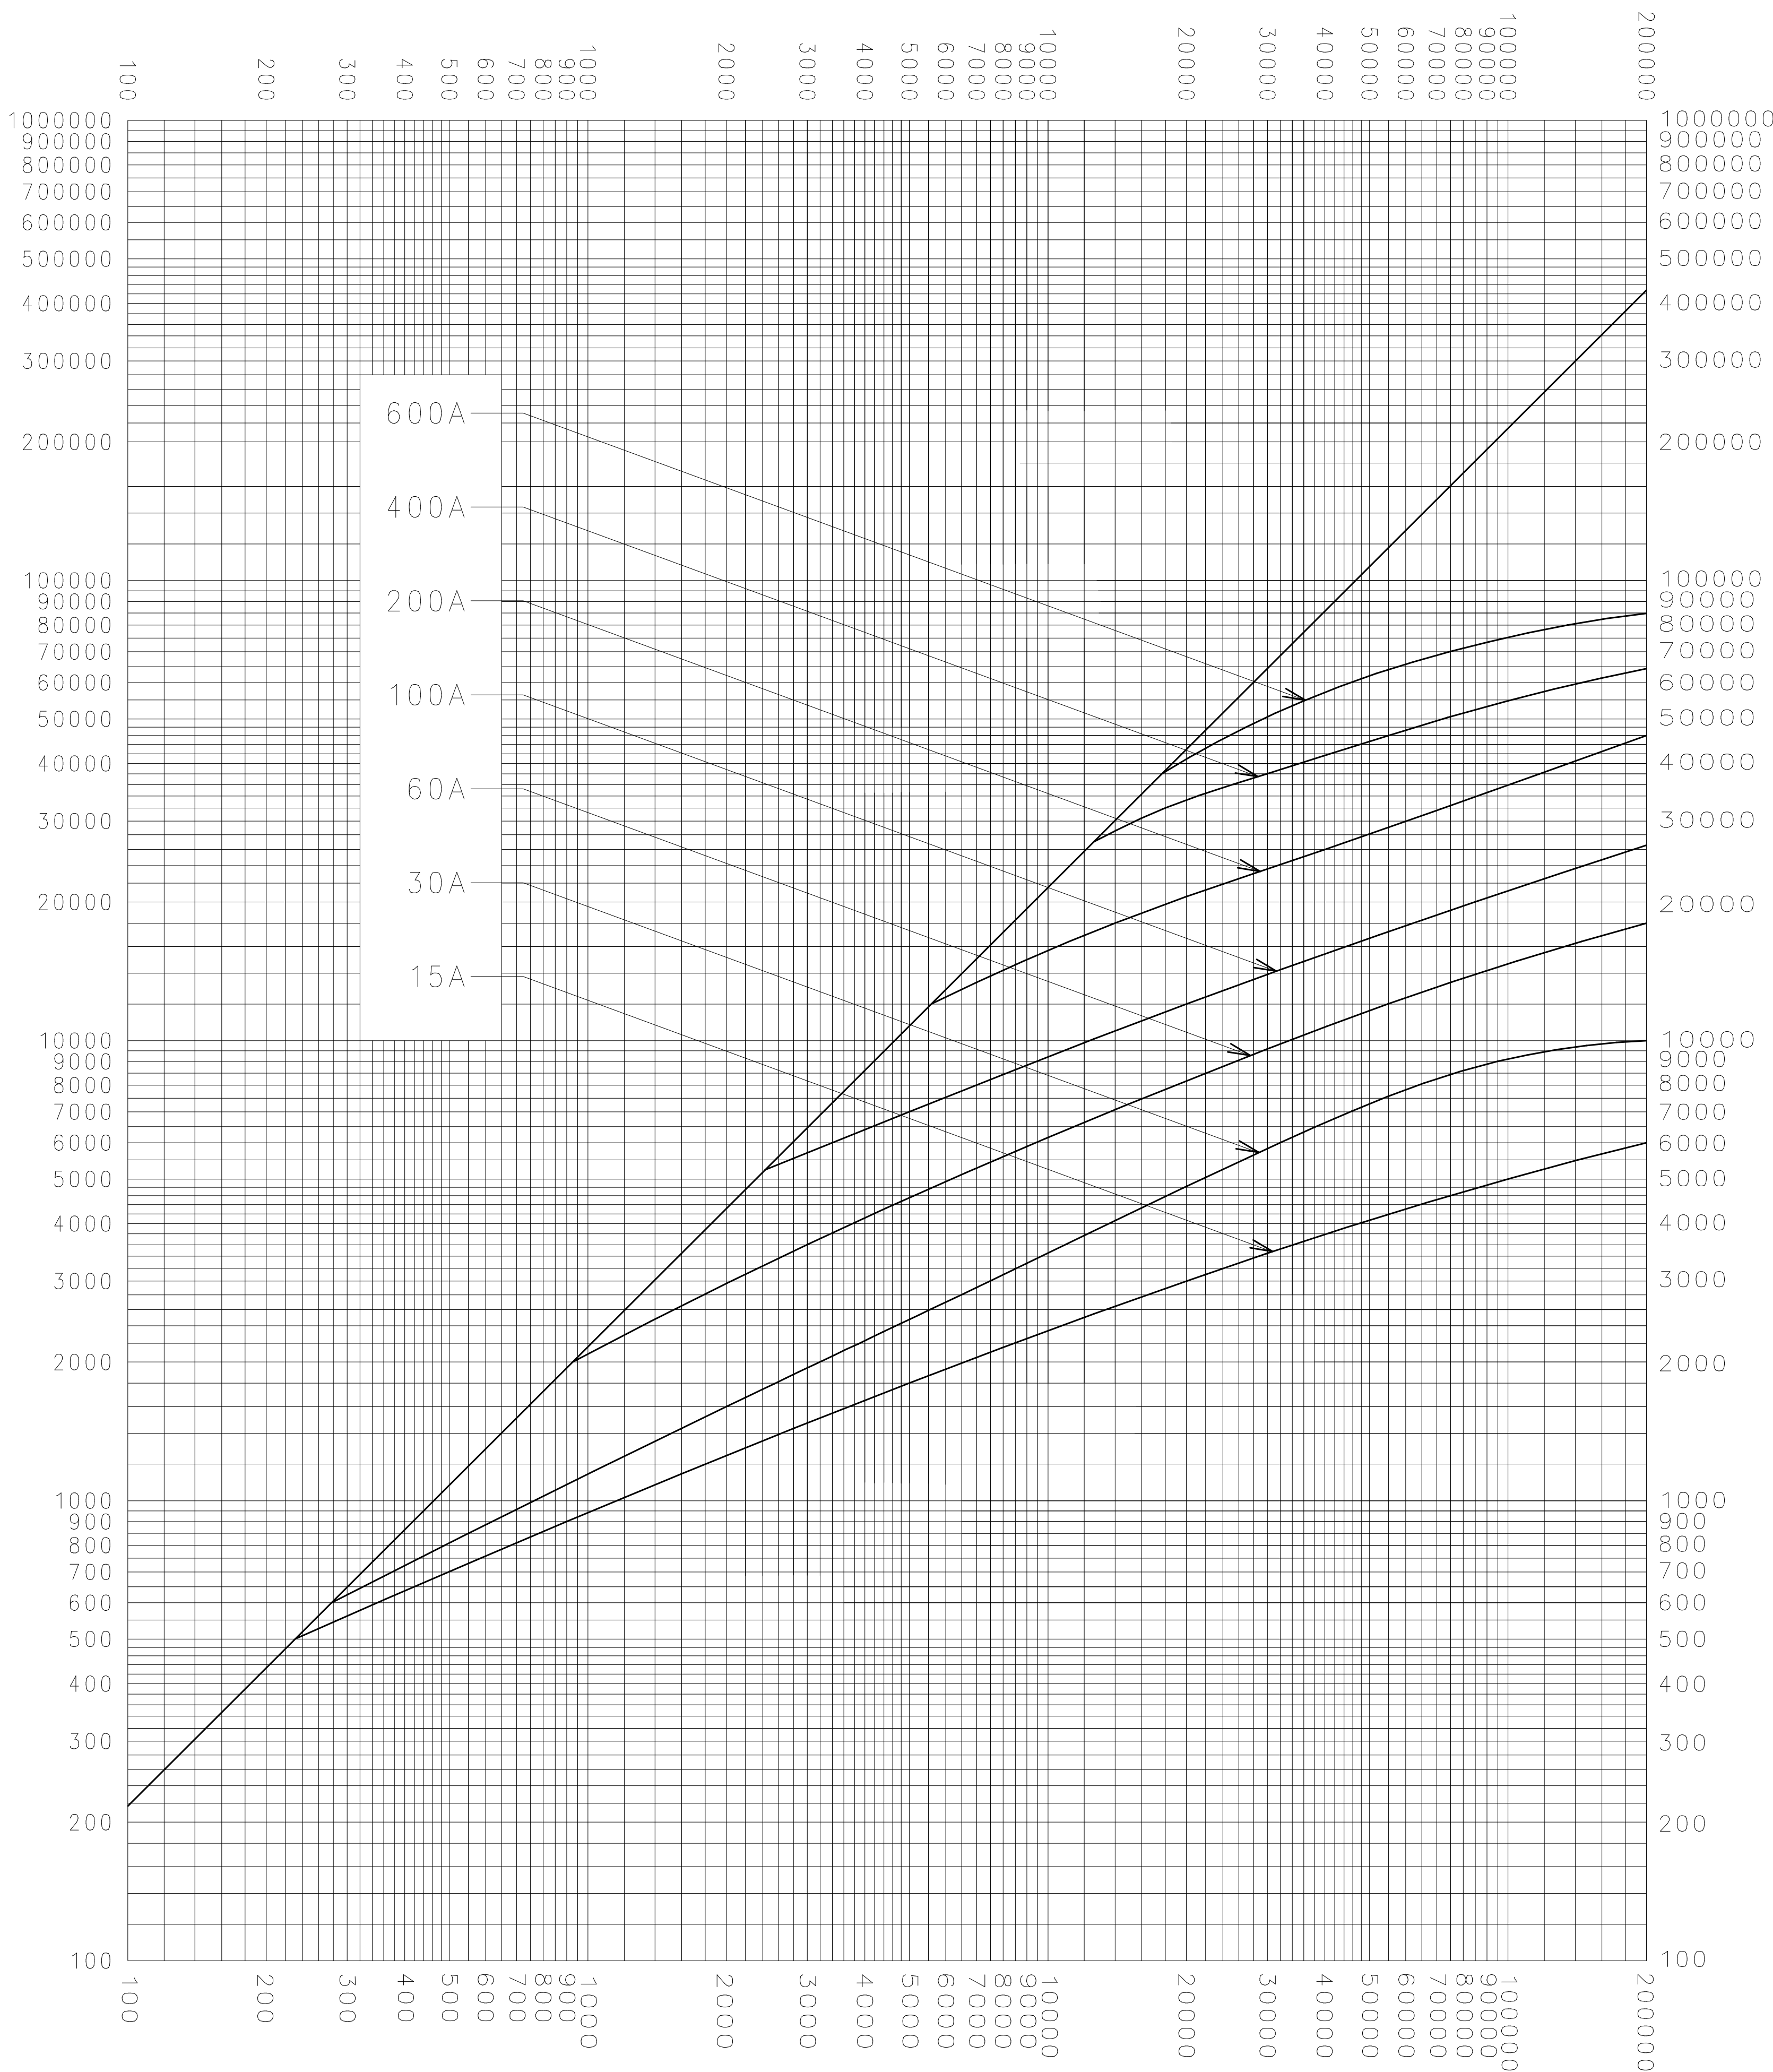


PEAK LET-THRU IN AMPERES

AVAILABLE FAULT CURRENT
SYMMETRICAL R. M. S. AMPERES

TEST VOLTAGE _____ TIME CONSTANT / POWER FACTOR _____
BASIS FOR DATA _____

FUSE CATALOG NUMBER
FLSR (15A - 600A) ID _____



LITTELFUSE, INC.
DES PLAINES, ILL. USA

DRAWN BY LLL
DATE 09/06/06
CHECKED BY MP

PEAK LET-THRU CHARACTERISTIC CURVES

DRAWING NO.
A-FCC05-FLSR-001

-THIS DATA GENERATED ON CAD-

UNCONTROLLED
DOCUMENT