


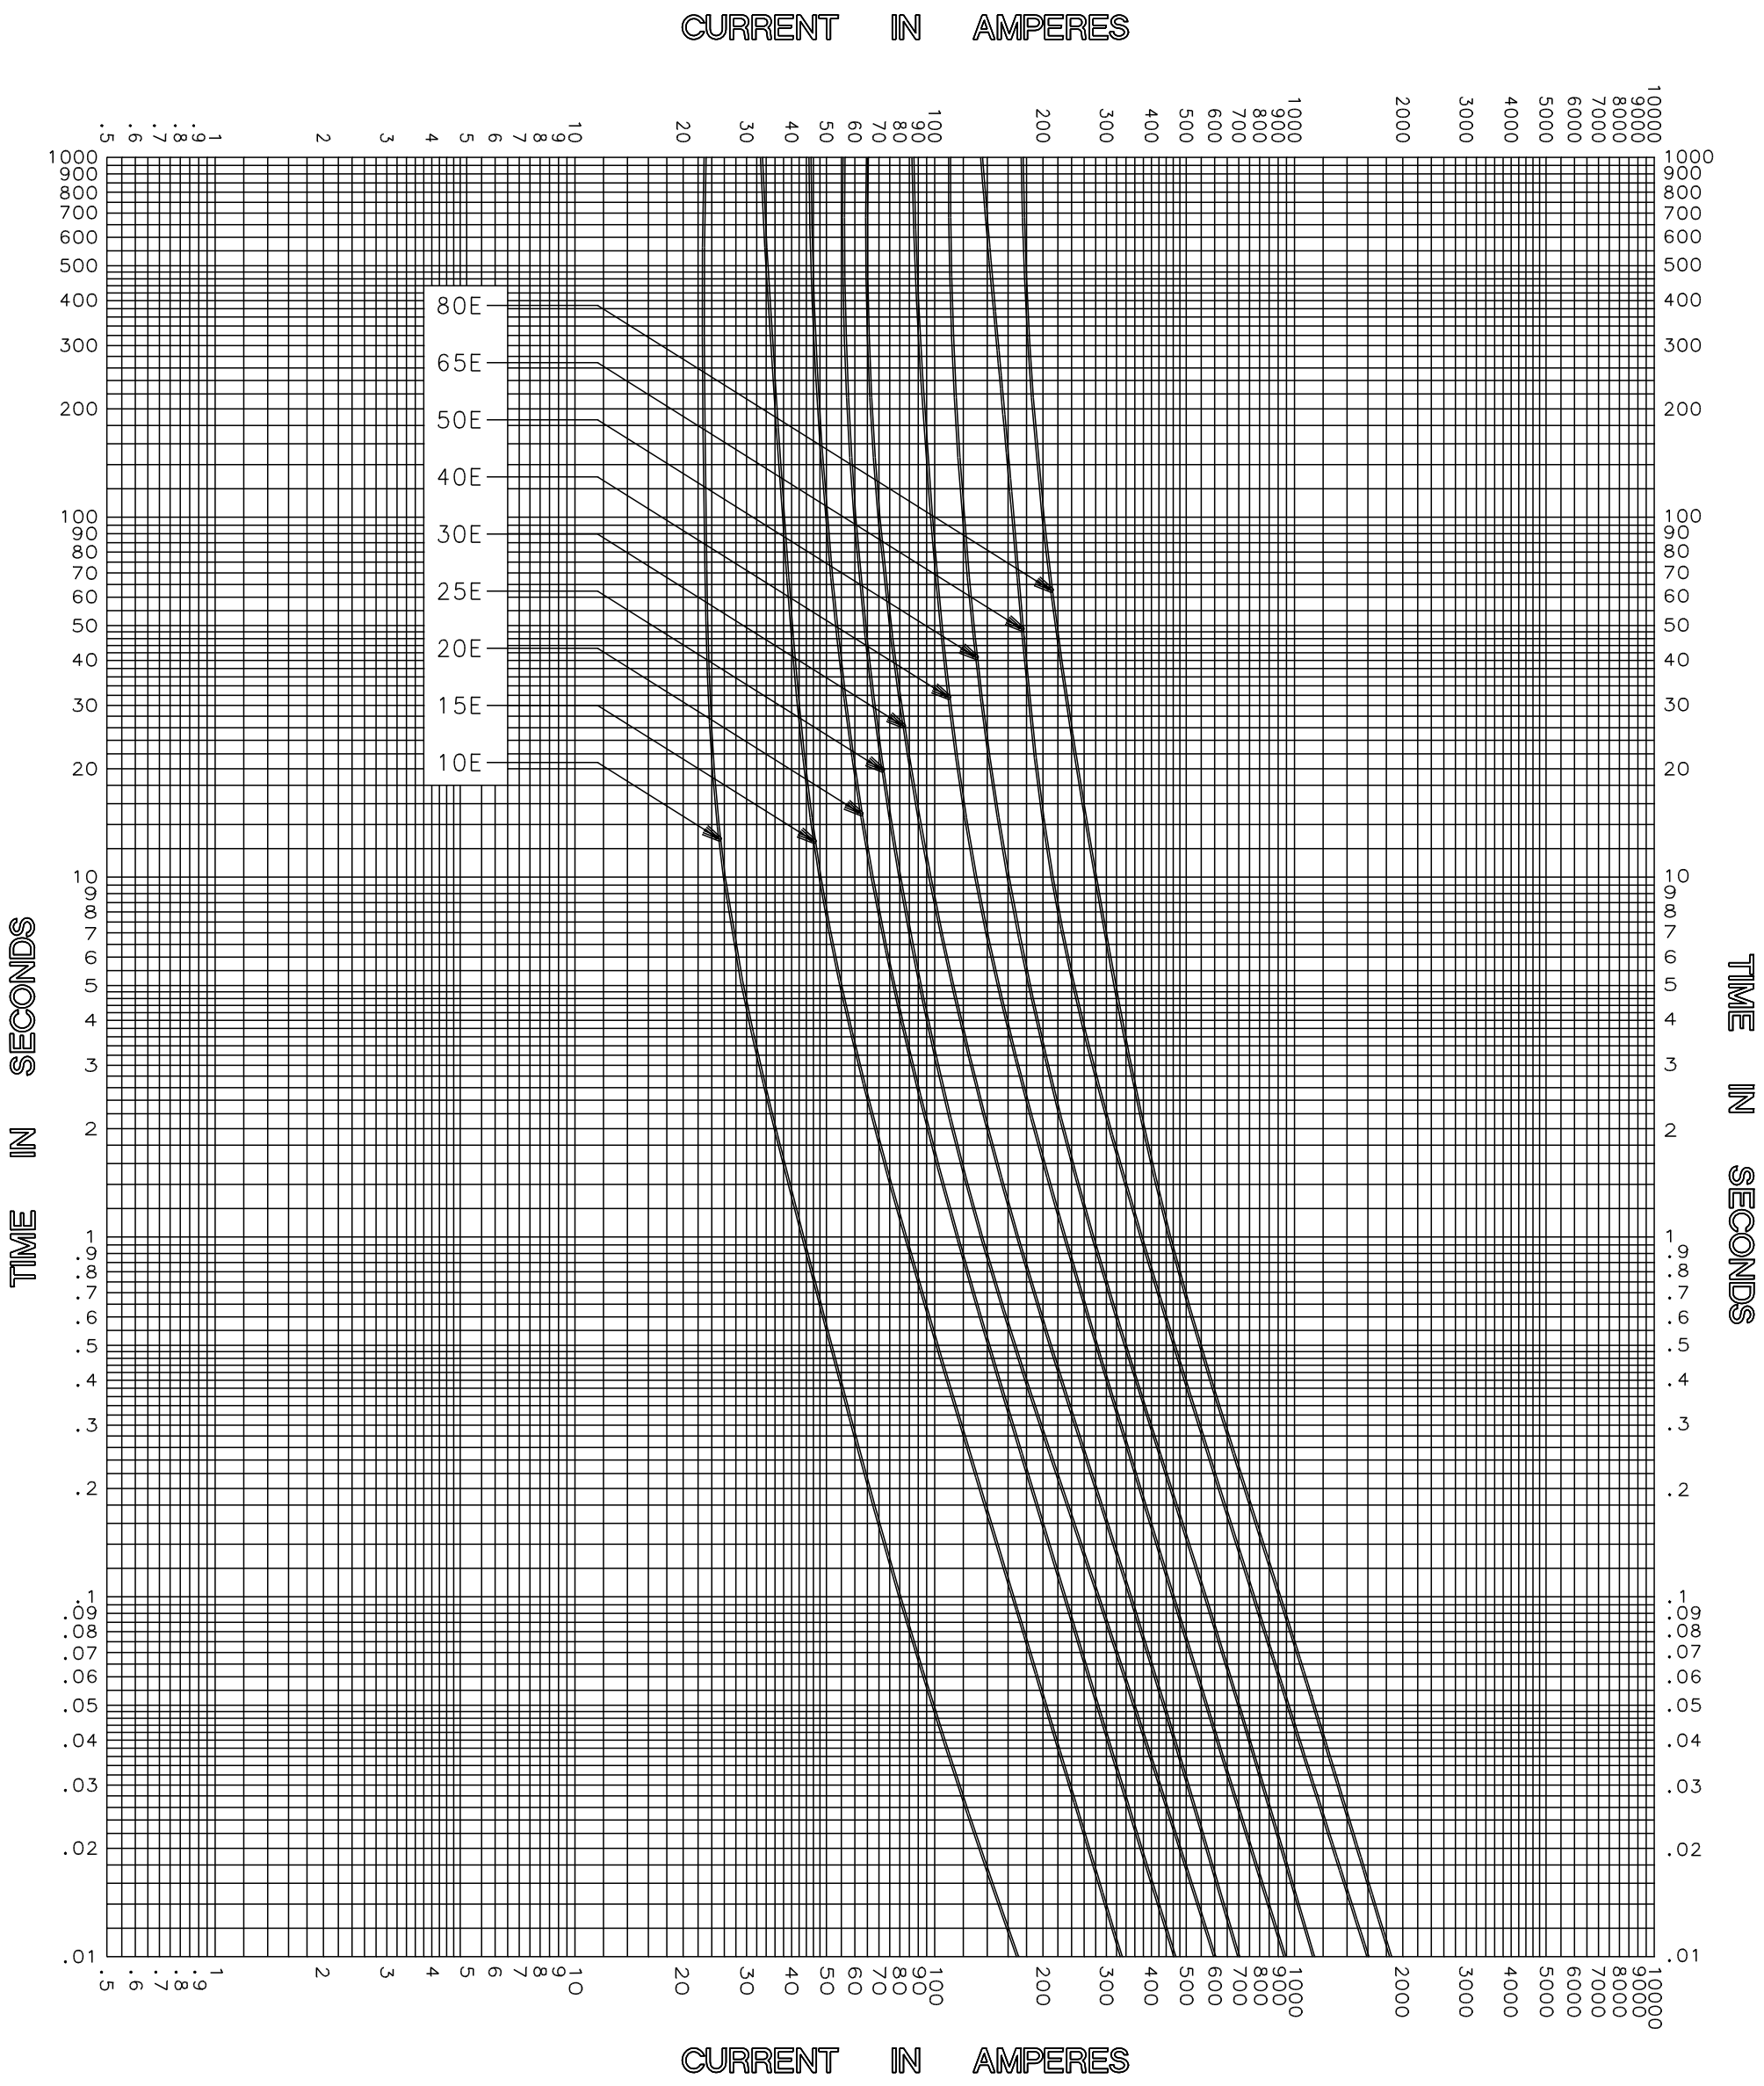

CLEARING TIME CHARACTERISTICS

TEST VOLTAGE _____ TIME CONSTANT / POWER FACTOR _____ BASIS FOR DATA _____	FUSE CATALOG NUMBER 8.25kV E-RATED 10E-80E
 Littelfuse® DES PLAINES, ILLINOIS 60016	DRAWN BY LLL DATE 07/26/04 CHECKED BY MP
TIME CURRENT CHARACTERISTIC CURVES	DRAWING NO. A-FCC04-250001

-THIS DATA GENERATED ON CAD-

UNCONTROLLED DOCUMENT